

High Voltage Energy 100Ah Storage System Battery



USER INSTRUCTION

This manual introduces high-voltage lithium batteries. Before installing the battery, please read this manual and carefully follow the instructions during the installation process. If you have any questions, please contact our company immediately for advice and technical support.











Catalogue

1. Symbol Description	4
2. Safety Precautions	5
2.1 Before Connecting	5
2.2 In Using	5
3. Introduction	6
3.1 Features	6
3.2 Specification	7
3.3 Equipment interface instruction	9
4. Safe Handling of Lithium-iron ESS Batteries Guide	12
4.1 Solution Diagram	12
4.2 Danger Label	12
4.3 Tool	12
4.4 Safety Gear	13
5. Installation and operation	13
5.1 Package items	13
5.2 Installation Location	13
5.3 Installation Steps	13
5.4 System turns on	14
5.5 System turns off	14
6. Emergency Situations	14
6.1 Battery Leakage	14
6.2 On Fire	14
6.3 Wet Batteries	14
6.4 Damaged Batteries	15
7. Remarks	15
7.1 Recycle and Disposal	15
7.2 Maintenance	15
Battery Parts List	16
PDU Parts List	16
Rack cabinet Parts List	16
Maintenance Record	17
Dear user.thank you for selecting our product,Please fill in and keep the warranty card for better services.	17

(Revision History)

Ver.No	Date	Revised Content	Reasons for Change	Reviser	Approve
A0	2024.01.16	First Edition	First Draft	ZhangDigen	
A1	2024.03.07	Second Edition	Parts List	ZhangDigen	
A2	2024.05.09	Third edition	Size change	ZhangDigen	
A3	2024.07.18	Fourth edition	Lamp board introduction	ZhangDigen	

1. Symbol Description

	Do not place near open fire or flammable materials.
	A potential hazard exists when the equipment is working. Wear personal protective equipment during operation.
	Warning electric shock. Power off the equipment before any operation.
	Grounding: indicate PE cable connection position.
	Do not place in areas accessible to children.
	Keep the battery away from open fire or ignition sources.
	Read the product and operation manual before operating the battery system.
	Label for Waste Electrical and Electronic Equipment (WEEE) Directive (2012/19/EU).
	The certificate label for CE.
	Recycle label.

2. Safety Precautions



Alert

- 1) It is important and necessary to read the user manual carefully (and attachment) before installing or using battery. Failure to do so or to follow any instruction or warning in this document can result in electrical shock, serious injury, and death, or damage battery, potentially rendering it unusable.
- 2) When battery is stored for a long time, it is required to charge once every 6 months, and the SOC should be no less than 50%.
- 3) After battery module cannot be discharged, it needs to be recharged within 12h.
- 4) Do not connect power terminal reversely.
- 5) All power supplies must be disconnected during maintenance.
- 6) Please contact the supplier within 24 hours if there is something abnormal.
- 7) Do not use any liquid to clean the battery.
- 8) Do not expose battery to flammable or irritating chemicals or vapor.
- 9) Do not paint any part of battery, including any internal or external components.
- 10) Do not connect battery with PV solar wiring directly.
- 11) Do not install or use this product beyond provisions of the manual.
- 12) Direct or indirect damages caused by the above reasons are not covered by warranty claim.



Warning

2.1 Before Connecting

- 1) Please check the external packaging condition before unpacking. If it is damaged, contact corresponding local retailer.
- 2) After unpacking, please check the products and spare parts according to spare parts list. If the product is damaged or missing, please contact your local retailer.
- 3) Connect to specified matching inverter.
- 4) Before installation, be sure to cut off the grid power and make sure battery switch is on OFF mode.
- 5) It is prohibited to connect the battery and AC power directly.
- 6) All electrical wiring must be connected in accordance with local regulations.
- 7) Please ensure that electrical performance of battery system is compatible with the equipment.
- 8) The installation onsite shall be equipped with fire-fighting facilities that meet relevant requirements, such as fire sand, dry powder fire extinguisher, etc.

2.2 In Using

- 1) If battery system needs to be moved or repaired, power must be cut off and battery is completely shut down.
- 2) It is prohibited to connect battery with different types of battery.
- 3) Do not connect battery to faulty inverter.

- 4) Except for personnel from The Company or other authorized personnel, batteries shall not be opened, repaired or disassembled. The company shall not bear any liability or responsibility caused by violation of any safety operation or design standard, production standard, equipment safety standards or any other standards or requirements.

3.Introduction

This rack mode battery is a new energy storage product developed and produced by The Company, which can provide reliable power supply for all kinds of equipment or systems.



Figure 3-1

3.1 Features

- 1) Built-in start function to reduce current impact.
- 2) When multiple modules are series connected, module addresses are set automatically.
- 3) Support for upgrading the battery module from the upper controller through CAN communication.
- 4) The module is non-toxic, non-polluting and environmentally friendly.
- 5) Cathode material is made from LiFePO₄ with safety performance and long cycle life.
- 6) Battery management system (BMS) has protection functions including over- discharge, over-charge, over-current and high/low temperature.
- 7) The system can automatically manage charge and discharge state and balance voltage of each cell.
- 8) Flexible configuration, multiple battery modules can be connected to expand capacity and power.
- 9) Adopted self-cooling mode rapidly reduced system entire noise.
- 10) The module has less self-discharge, no memory effect, excellent performance of shallow charge and discharge.

Functions


Protection and Alarm	Management and monitor
Charge/Discharge End	Cell Balance
Over voltage Charging Protection	Intelligent Charge Model
Under Voltage Discharging Protection	Charge/Discharge Current Limit
Charge/Discharge Over current Protection	Capacity Retention Calculate
High/Low Temperature Protection	Soft start
Short Circuit Protection	History Record

3.2 Specification

Parameters

No.	Items	Specification
1	Product Name	Rechargeable Lithium Iron Phosphate Module
2	Module Model	HJ-51.2V100Ah
3	Battery Type	LFP 1P16S
4	Nominal Capacity	5.12kWh(*Module Qty)
5	Usable Capacity	4.608kWh (*Module Qty, 90% DOD)
6	Nominal Voltage	51.2V(*Module Qty)
7	Working Voltage	46.4~57.6V(*Module Qty)
8	Charging Voltage	56V(*Module Qty)
9	Max. Charge Current	100A
10	Max. Discharge Current	100A
11	Communication	RS485 , CAN
12	Storage Temperature	-20°C ~ 55°C (Recommended)
13	Working Temperature	Charge: 0°C ~ 55°C Discharge: -30°C ~ 55°C
14	Working Humidity	≤85% (RH) No Condensation
15	Working Altitude	≤2000m
16	Ingress Protection	IP20
17	Protective Class	IP20
18	Weight	~41kg(*Module Qty)
19	Dimension	440mm*421mm*165mm(1 Module)
20	Design Life	10 Years (25°C)
21	Cycle Life	> 6000 (25°C) ,80% DOD
22	Scalability	Module: Max. 12


Dimensions

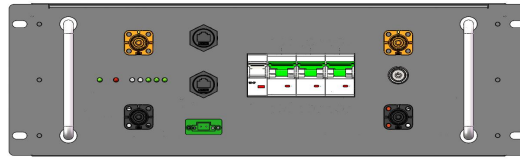

High voltage box



Battery module

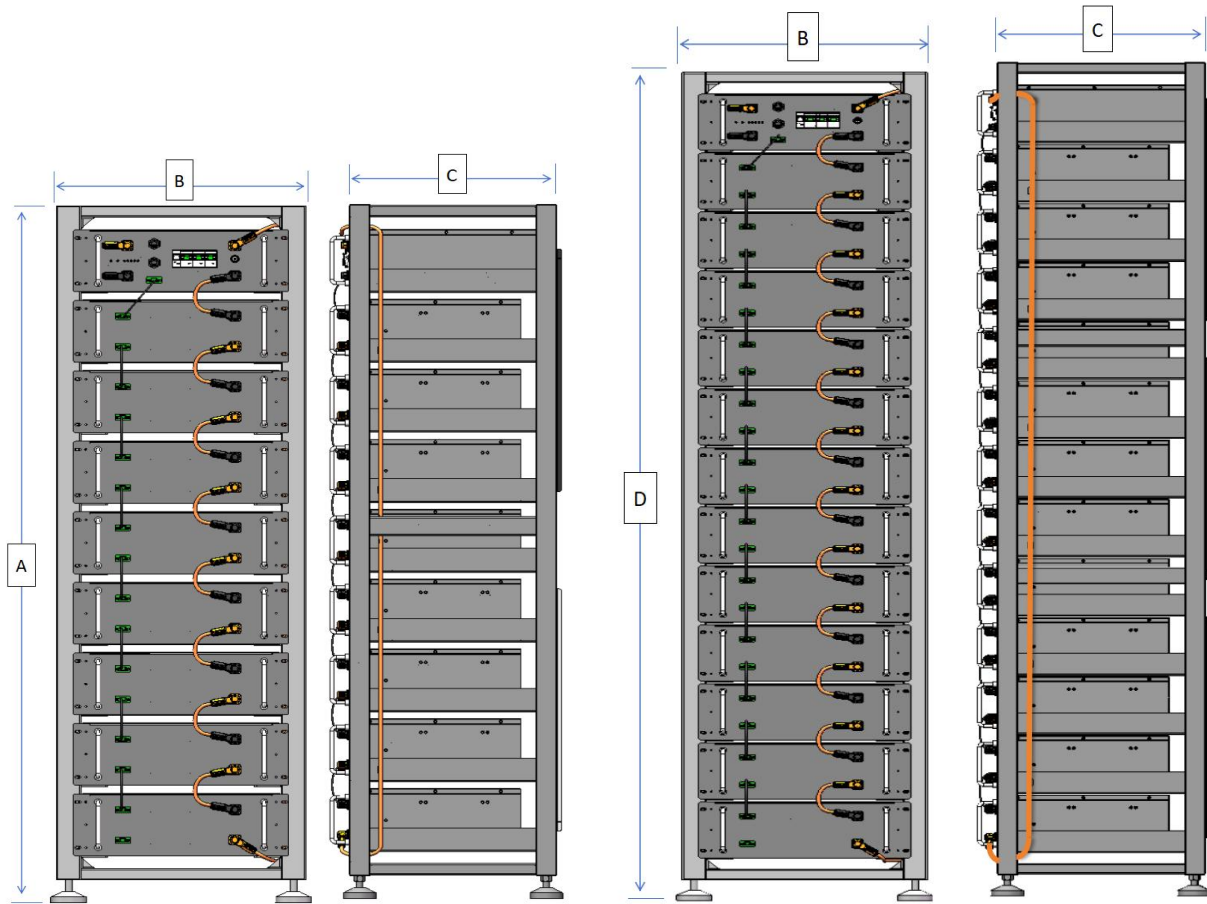

Pedestal
Figure 3-2

model		Size	
A	B	C	D
1841 mm	546 mm	506 mm	2418 mm

3.3 Equipment interface instruction

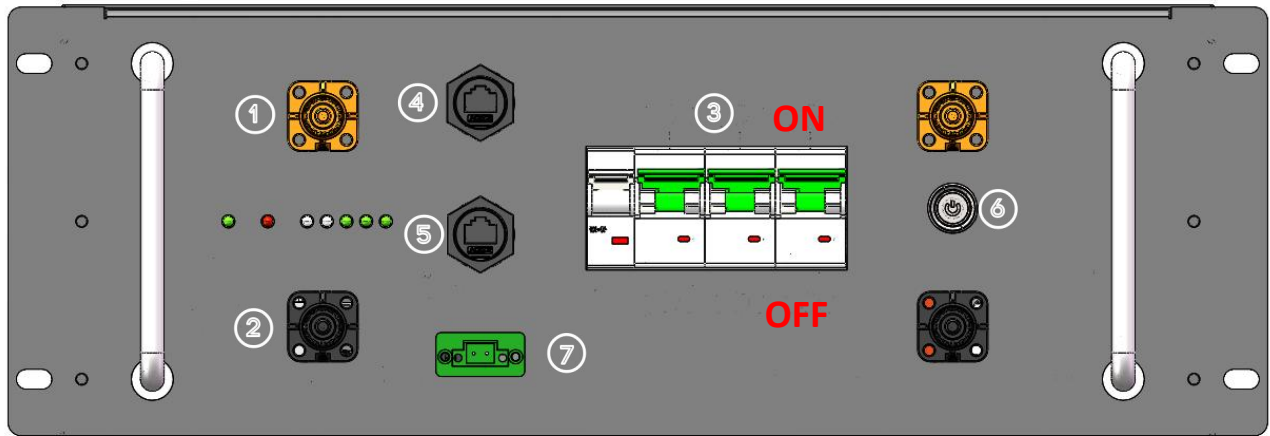


Figure 3-3


- ① **Positive terminal:** battery positive output--Connect 6AWG cable
- ② **Negative terminal:** battery negative output--Connect 6AWG cable
- ③ **Breaker:** control circuit output, turn the switch to ON when use
- ④ **PCS:** battery communication with PCS by RJ45 8P8C
- ⑤ **DEBUG:** Maintenance inspection port
- ⑥ **Start :** System start switch, Press the button BMS will works
- ⑦ **PORT:**Slave communication

➤ Start

Start button: When battery is dormant, press the START button to start the battery module.

➤ Operating mode indication

The start button led lighting to show the battery system is running or having alarm.

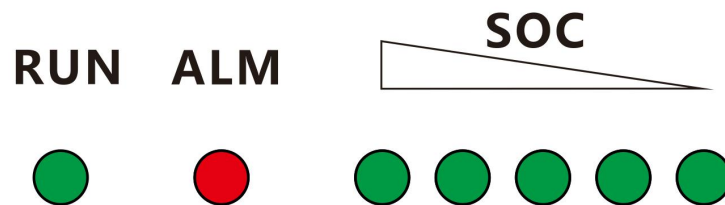

Light Blink explanation

Flash mode	ON	OFF
Flash 1	0.5S	2S
Flash 2	1S	1S
Flash 3	2S	2S

State indication

State	RUN	ALM
Power Off	OFF	OFF
Standby	ON	OFF
Other protection alarms	ON	Flash 1
Overcharging protection	ON	Flash 2
Over discharge protection	ON	Flash 3
Close charge Close discharge/Relay is normal	ON	ON
Overcharging protection and relay failure	OFF	Flash 2
Over discharge protection and relay failure	OFF	Flash 3
Over discharge protection, over charge protection, and relay failure	OFF	ON

Capacity indication

SOC	LED4	LED3	LED2	LED1
85%~100%	ON	ON	ON	ON
75%~85%	Flash 2	ON	ON	ON
60%~75%	OFF	ON	ON	ON
50%~60%	OFF	Flash 2	ON	ON
35%~50%	OFF	OFF	ON	ON
25%~35%	OFF	OFF	Flash 2	ON
10%~25%	OFF	OFF	OFF	ON
5%~10%	OFF	OFF	OFF	Flash 2
0%~5%	OFF	OFF	OFF	OFF

➤ Breaker

When the circuit breaker is pushed to the ON position, Positive Power Terminal will connect with the HV+ battery contactor and Negative Power Terminal will connect with the battery HV-, on the other hand, when the circuit breaker at OFF position both connection will off.


Attention:

It is strictly prohibited to turn off the circuit breaker switch first when the inverter is charging and discharging the battery

➤ PCS port

Be used to communicate with inverter or upper battery.

RJ45 Socket




Pin	Definition
1	/
2	/
3	CAN1G
4	CAN1H
5	CAN1L
6	RS485G
7	RS485A
8	RS485B

➤ **DEBUG port**

Maintenance inspection port


RJ45 Socket



Pin	Definition
1	CAN0H
2	CAN0L
3	/
4	CAN1H
5	CAN1L
6	/
7	RS485A
8	RS485B

➤ **port**

Slave communication

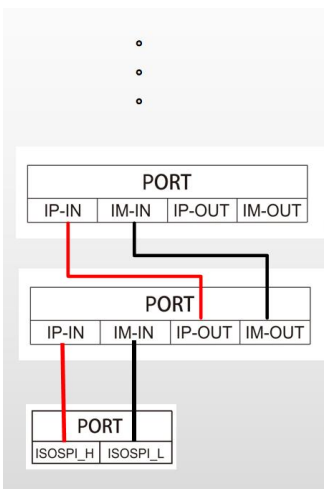

Pin	Definition
1	ISOSPI-H -----IP-IN
2	ISOSPI-L -----IM-IN

4. Safe Handling of Lithium-iron ESS Batteries Guide

4.1 Solution Diagram

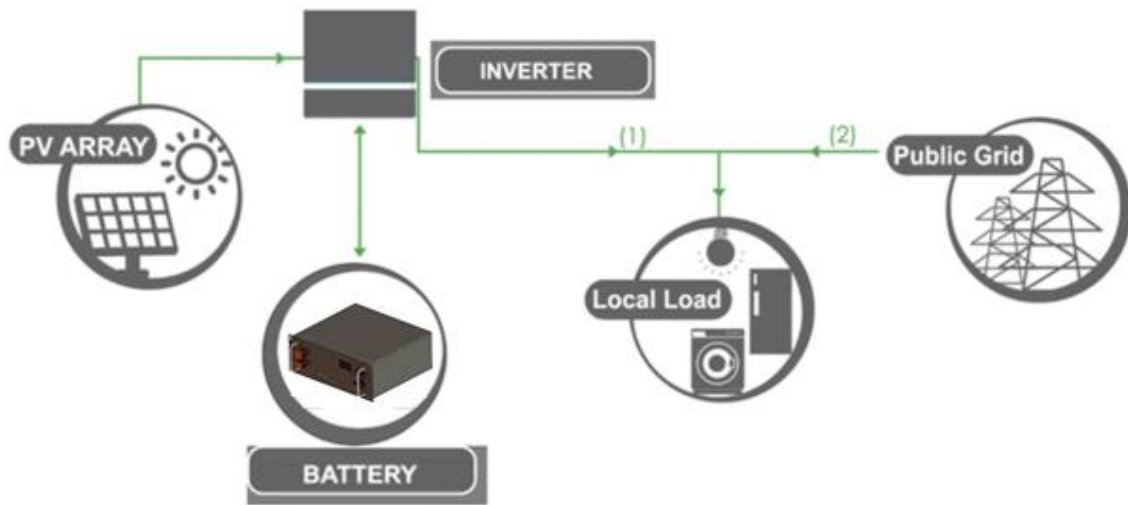


Figure 4-1

4.2 Danger Label



Figure 4-2

4.3 Tool



Wire Cutter



Modular Crimping Pliers



Screwdriver



Electric drill

Note

Properly use insulated tools to prevent accidental electric shock or short circuits. If tools are not insulated, cover the entire exposed metal surfaces of available tools with electrical tape except their tips.

4.4 Safety Gear

It is recommended to wear the following safety gear when dealing with battery pack.



Insulated Gloves



Safety Goggles



Safety Shoes

5. Installation and operation

5.1 Package items

Unpacking and check the Package items

1) For battery module package:

- Battery Module

2) For packing box of high voltage box:

NOTE: Power and communication cables connect to inverter belongs to the packing box of high voltage box.

5.2 Installation Location

Make sure that installation location should meet the following condition:

- 1) The area should be completely water-proof.
- 2) The floor should be flat and level.
- 3) No flammable or explosive materials.
- 4) The ambient temperature is within the range from 0°C to 45°C.
- 5) The temperature and humidity are maintained at a constant level.
- 6) There is just a little dust and dirt in the area.
- 7) The distance from heat source should be more than 2 meters.
- 8) The distance from air outlet of inverter is more than 0.5 meters.
- 9) Installation areas should avoid direct sunlight.
- 10) No forced ventilation requirement for battery module, but please avoid installing in a closed area.

Ventilation shall avoid high salinity $\leq 30\%$, humidity $\leq 85\%$ and ambient temperature of 0 ~ 45 °C.

5.3 Installation Steps



Warning

- 1) Follow local electric safety and installation policy, a suitable breaker between battery system and inverter is required.
- 2) All installation and operation must follow local electric standard and requirements.
- 3) When battery modules are connected in series, the system should be powered off before installation operation.

5.4 System turns on

Warning: Double check all the power cables and communication cables. Make sure the voltage of the inverter/PCS is same level with the battery system before connection. Check all the power switches are OFF.

System turns on step:

- 1) Check all cables are connected correctly. Check grounding is connected.
- 2) If necessary, turn on the switch at inverter's battery side or between inverter and battery. If possible, turn on AC or PV power source to wake up inverter.
- 3) And turn on power switch.
- 4) Switch all the battery racks' Isolating Switch to on position.
- 5) Press the start button in sequence. If there is a button switch on the battery layer, first turn on the metal start button of the battery, and finally turn on the start button of the battery box control box(PDU).
- 6) If no alarm ,the battery system will be ready for charging and discharge with PCS.

5.5 System turns off

When failure or before service, must turn the battery storage system off:

- 1) Turn off inverter or power supply on DC side.
- 2) Turn off the switch between PCS and battery system.
- 3) Switch Isolating Switch to off position. (Switch off the slave battery firstly, finally switch off the master battery).

Note

- 1) One battery system shall just have one master, all the others are slaves. (The one on the extreme side connected to inverter is the master battery.)
- 2) It is forbidden to switch off the Isolating Switch during charging and discharging.

6. Emergency Situations

6.1 Battery Leakage

If the battery pack leaks electrolyte, avoid contact with the leaking liquid or gas. If one is exposed to the leaked substance, immediately perform the actions described below.

- 1) Inhalation: Evacuate contaminated area and seek medical aid.
- 2) Contact with eyes: Rinse eyes with flowing water for 15 minutes and seek medical aid.
- 3) Contact with skin: Wash affected area thoroughly with soap water and seek medical aid.
- 4) Ingestion: Induce vomiting and seek medical aid.

6.2 On Fire



NO WATER!

Only dry powder fire or carbon dioxide extinguisher can be used; if possible, move the battery module to a safe area before it catches fire.

6.3 Wet Batteries

If the module is wet or submerged in water, do not let people access it, then contact us or an authorized dealer for technical support. Cut off all power switch on inverter side.

6.4 Damaged Batteries

Damaged batteries are dangerous and must be handled with utmost care. They are not fit for use and may pose a danger to people or property. If the module seems to be damaged, pack it in its original container, then return it to authorized dealer.



Warning

Damaged batteries may leak electrolyte or produce flammable gas.

7. Remarks

7.1 Recycle and Disposal

In case a battery (normal condition or damaged) needs disposal or needs recycling, it shall follow the local recycling regulation (Suggest Regulation (EC) N° 1013/2006 among European Union) to process, and using the best available techniques to achieve a relevant recycling efficiency.



7.2 Maintenance

Check installation environment such as dust, water, insect etc. Make sure it is suitable for IP20 battery system. Connection of power connector, grounding point, power cable and screw are suggested to be checked every year.

Battery Parts List

Item	Part Name	Description	Unit	Quantity
1	Battery layer	Optional up to 12 floors	PCS	3-12
2	Battery power cable	6AWG black- orange	PCS	Same as the number of batteries
3	Communication cable	Battery series connection cable	PCS	Same as the number of batteries
4				
5				

PDU Parts List

Item	Part Name	Description	Unit	Quantity
1	PDU	Battery box control box	PCS	1
2	PDU power cable	6AWG black-black	PCS	1
3	Positive terminal	Orange Connect 6AWG cable	PCS	1
4	Negative terminal	Black Connect 6AWG cable	PCS	1
5	Instructions		PCS	1

Rack cabinet Parts List

Item	Part Name	Description	Unit	Quantity
1	Rack cabinet	Optional: 9layer or 13layer	PCS	1
2	Rack cabinet power cable	Optional : 9layer:6AWG orange- orange (1950mm) 13layer:6AWG orange- orange (2510mm)	PCS	1
3	Hexagon screw	M5*12	PCS	9layer:100 13layer:120
4				
5				

Maintenance Record

Dear user.thank you for selecting our product,Please fill in and keep the warranty card for better services.

Attn: _____ Product No.: _____

Tel: _____ E-mail: _____

Purchase Date: _____

Address: _____

Maintenance Record			
Date of repair	Content	Maintenance Personnel	Note



Suzhou Preta Intelligence and Technology Co.,Ltd

Add: No..55 Shangxiang Road, Huaqiao Corporation Head Quarter Centre, Kunshan City, Suzhou City, China

Tel: 0512-36684019

Email: info@pretapower.com

Web: <https://pretapower.com/>